


**General Notes:**  
 Second Floor and Attic protected by Dry System  
 Throughout  
 Elevation of Mains and Branch Lines 8" above top cord of lower truss  
 Slope Mains 1/4" per 10' and Branch Lines 1/2" per 10'  
 Dry Pendent Sprinklers protecting 2nd Floor below  
 Coordinate with Mechanical and Electrical Trades

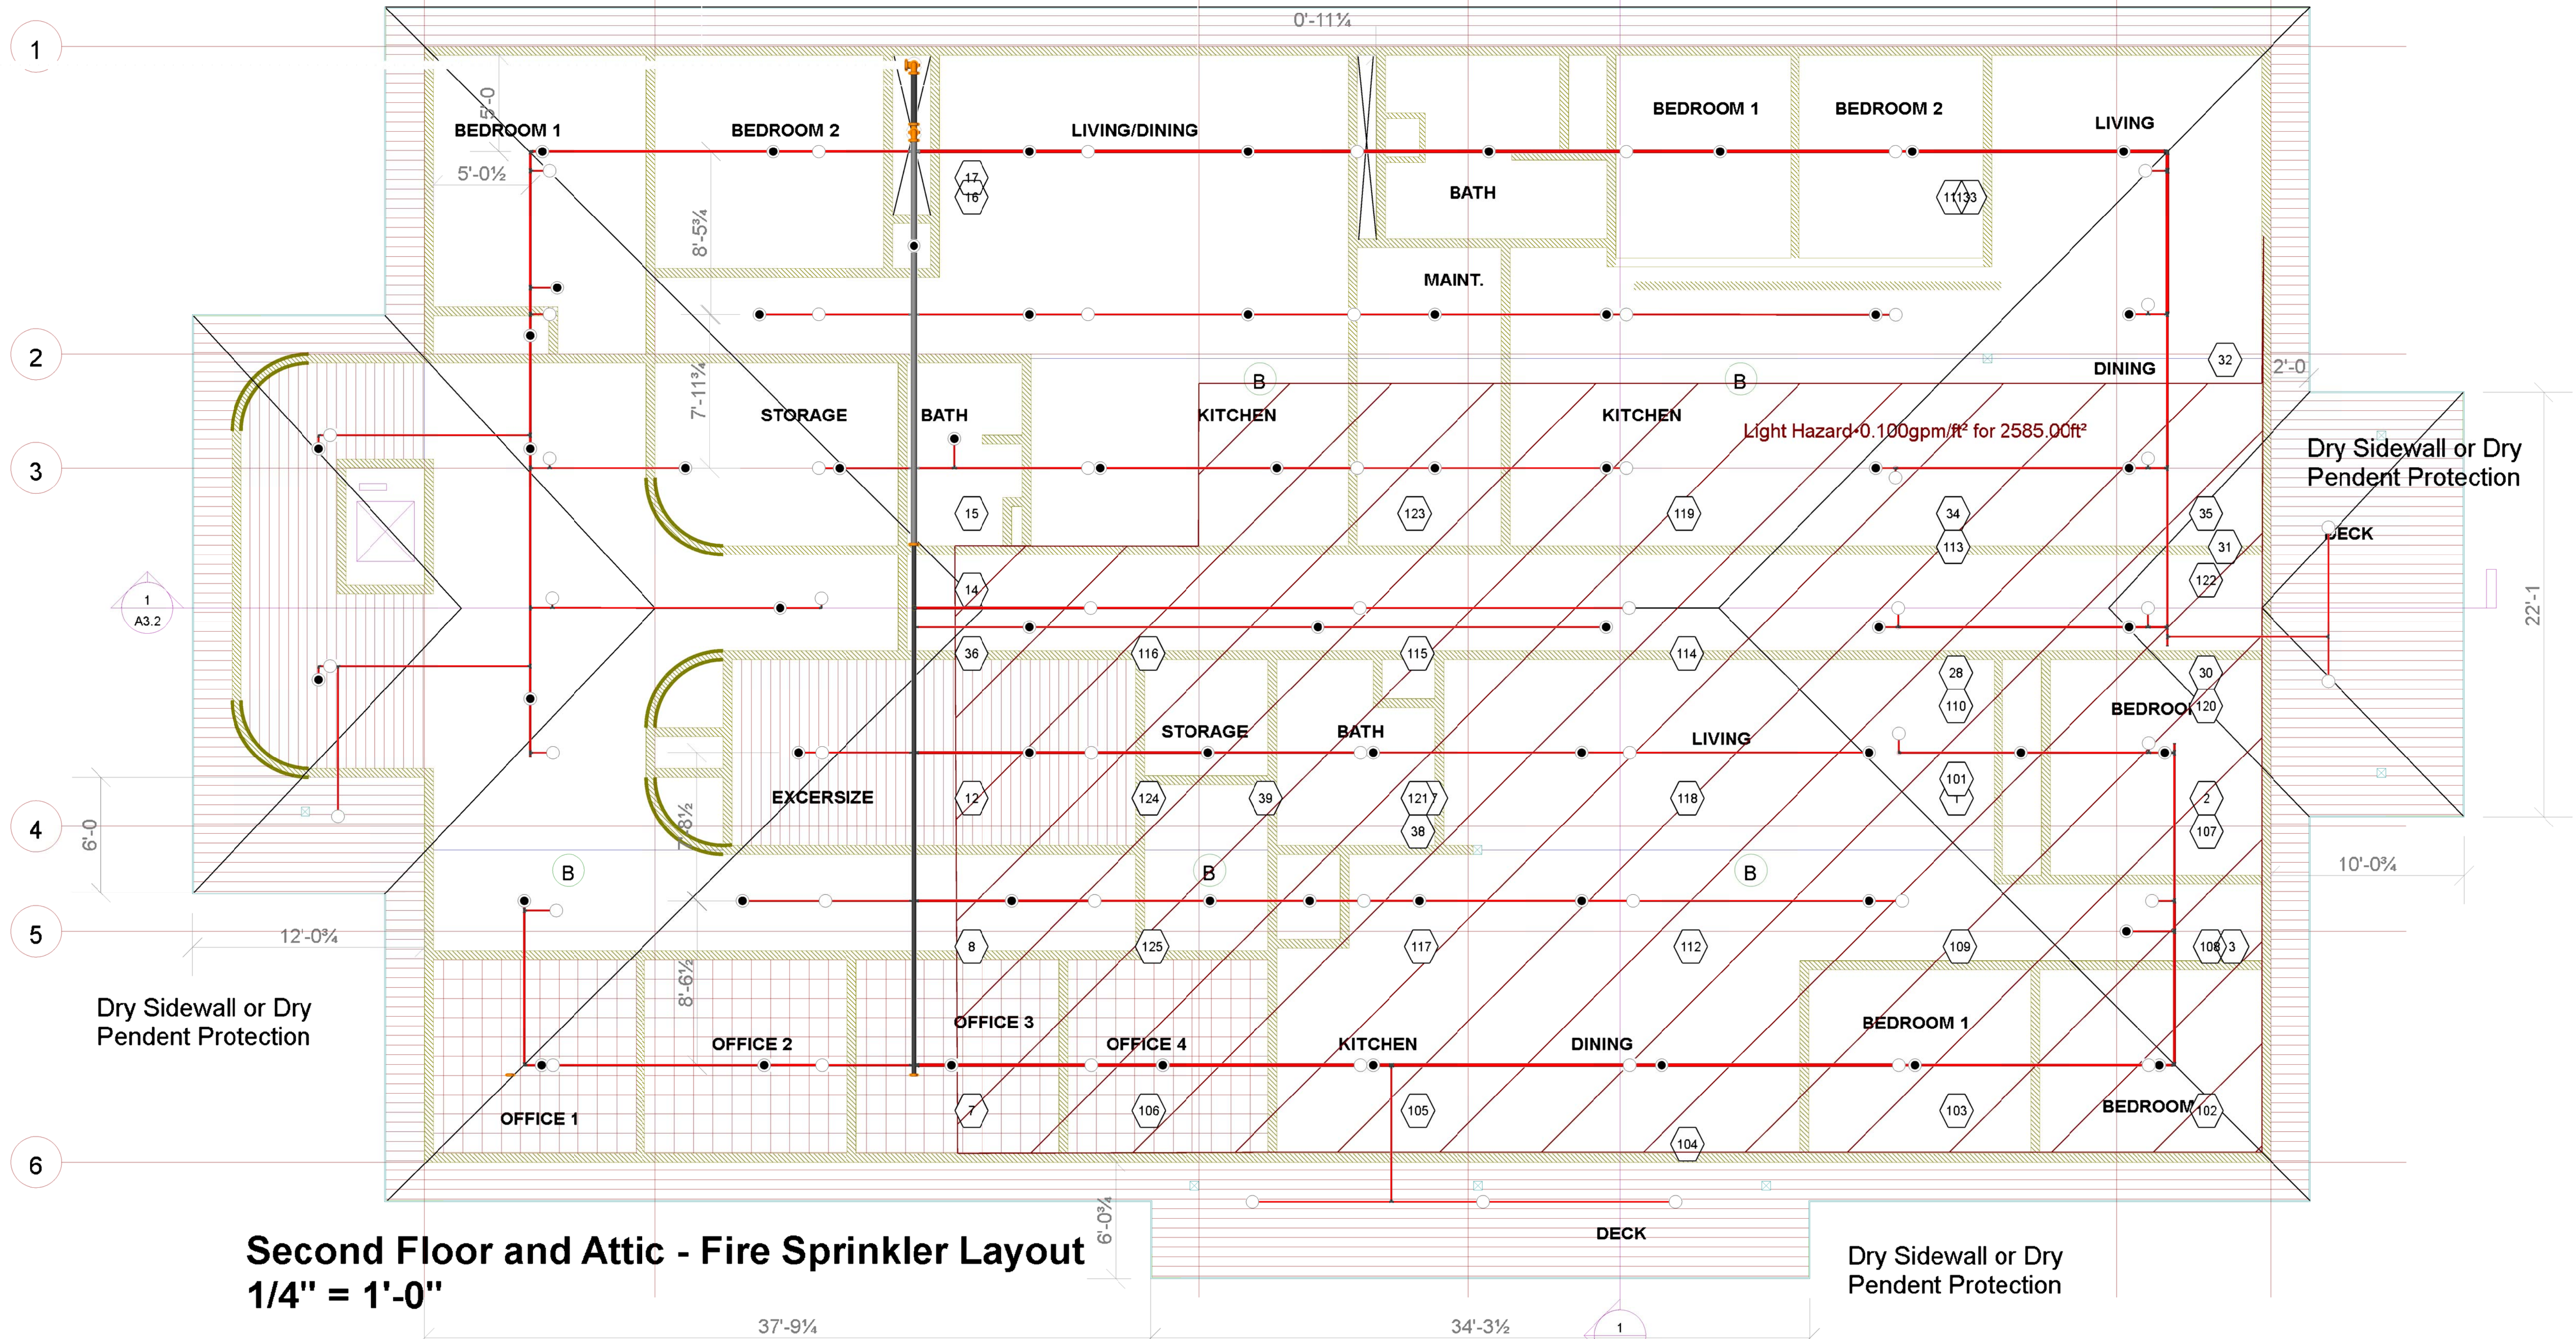

**Second Floor and Attic - Fire Sprinkler Layout**  
 1/4" = 1'-0"

	<b>Piping Color Legend</b> - Wet System Branch Line - Wet System Main	<b>Key Plan</b>

Revisions

		<b>Chinook Fire Protection, Inc.</b> 1221 E. 70th Ave. Anchorage, AK 99518	
		Permit Holder 	Customer: SSAJ Architects 2nd Floor and Attic Fire Sprinkler Layout
PERMIT NUMBER: 94-018 NICET IV	Job No. 17C-001 Date 11/02/17 Drawn By Jeffrey Wilcheck Scale 1/8" = 1'-0"	Ouzinkie Office Building Ouzinkie, Alaska	<b>FP-03</b>

Project: Ouzinkie Office Building Sheet: FP-03  
 Plot Date: 11/17/17 09:43:03AM